



FFUs with standard motor

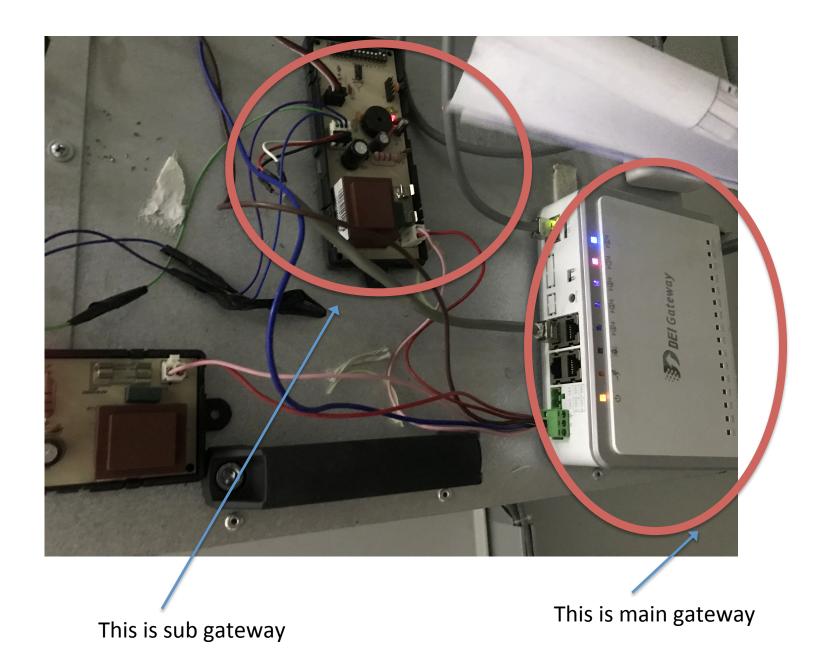


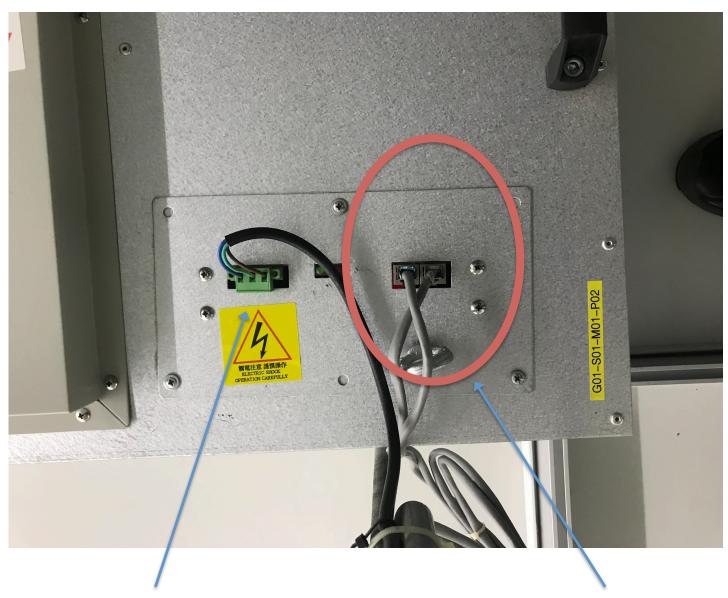

Power supply

Central control cable connected In series

If FFUs quantity is more then 60 pcs, they only can be controlled via main gateway plus sub gateway

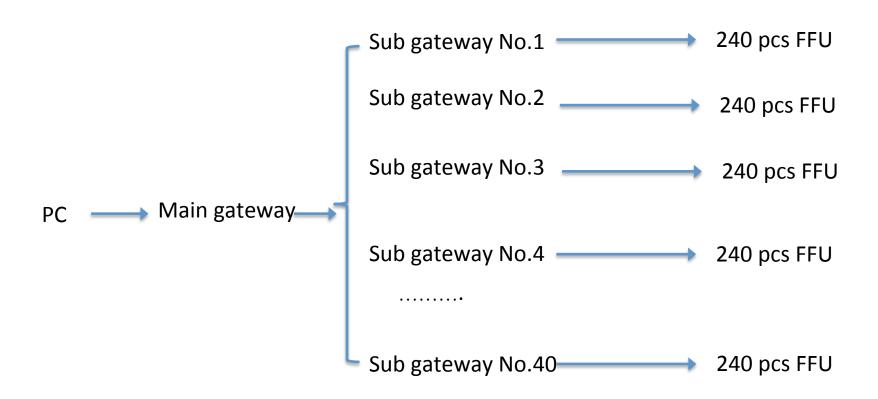

Protocol: modbus TCP/IP

If FFUs quantity is less then 60 pcs, they can be controlled Via one sub gateway



